

DT1000 GSCloud Monitoring Communication Module User Manual



Software Version

No.	Version	Date	Note
1	V1.0	2020-09-1	Original release.
2	V1.1	2023-12-04	Increase controller model.
3	V1.2	2024-07-24	Add WIFI frequency band description.



Chongqing Mebay Technology Co.,Ltd

Add: No6-2,Building 4, Gangan Rd, Jiangbei District, Chongqing.

Tel: +86-23-6869 3061

Fax: +86-23-6765 8207

Web: <http://www.mebay.cn>

<http://www.cqmb.cn>

E_mail: sales@mebay.cn

Symbol Description

Symbol	Description
 Note	Remind operators to operate correctly, otherwise it may cause the equipment not to work correctly.
 Be care	It is indicated that potential hazards can damage equipment without proper precautions.
 Warning	It is indicated if appropriate preventive measures are not taken, potentially dangerous situations may result in death, serious personal injury or significant property losses.

**Warning**

1. The installation of this equipment must be carried out by professionals.
2. When installing and operating the controller, please read the entire instruction manual first.
3. Any maintenance and commissioning of the equipment must be familiar with all the equipment

**Be Care**

1. Please keep the good connection of the power supply of the controller. Do not share the connection lines of the positive and negative electrodes of the battery with the floating charger.
2. During the operation of the engine, do not disconnect the battery, otherwise it may cause damage to the controller.

Catalogue

Summary	6
Main Features	6
Parameters	6
Overall Dimension and Wiring Diagram	7
Installation instruction	8
Panel and display Instruction	9
Operation	10
Parameter list	12
Fault Finding	14

Notes:

1. All rights reserved. No part of this duplication may be reproduced in any material form (including photocopying or storing in any medium by electronic means or others) without the written permission of the copyright holder.
2. MEBAY Technology reserves the rights to change the contents of this document without prior notice.

Summary

DT1000 is the data acquisition and communication module of GSCloud® generator set cloud control system developed by our company, which is WIFI/ET version. Its main function is to connect the generator set controller to the interconnection network, to realize the computer PC terminal and mobile phone APP remote real-time monitoring generator set, to realize the remote control unit, remote data monitoring, remote fault diagnosis, unit position real-time positioning, maintenance management and so on.

It has RS485 communication port, which can read and write the commonly controlled data. The internal integration of GPS module can realize the positioning of the unit. The communication module adopts European lock terminal, the connection is firm and the installation is convenient.

Main Features

- ◆ DT1000:Support WIFI/ET network,GPS, with RS485 and other functions;
- ◆ It can be connected to cloud server through WIFI wireless network or Ethernet interface, and one communication module can monitor one generator set;
- ◆ Using ARM kernel 32bit single chip microcomputer, processing speed, strong expansion ability.
- ◆ Wide range of working power supply DC (8 ≤ 36) V.
- ◆ With USB-B interface, DTU parameters can be set through the PC;
- ◆ It has good extended function, extensible environment detection, other equipment parameter detection and other modules.
- ◆ Data communication protocol using encryption algorithm.
- ◆ a compression algorithm is adopted to greatly reduce the flow consumption.
- ◆ the module is provided with the GPS positioning and the base station positioning function, and the real-time positioning of the unit can be realized.
- ◆ with two sets of programmable switch quantity input ports.
- ◆ When the generator set alarm, can immediately upload data to the server.
- ◆ the working state of the module is indicated by the LED indicating lamp, and the working state of the module is conveniently realized by the user in real time.
- ◆ The installation or screw fixation of the standard type 35mm guide rail is adopted.
- ◆ Modular structure design, ABS shell, light weight, compact structure, easy to install.


Parameters

Options	Parameters
Working voltage	DC8V----36V Continuous
Power consumption	Standby: 24V: MAX 1W
	Working: 24V: MAX 5W
USB Device	Type B USB port
RS485	Isolated
WIFI	SMA Port antenna and support.
GPS	SMA port

WIFI frequency band	2.4GHz, supports 802.11b/g/n standard.
Ethernet	RJ45 Port,10/100Mbps self-adaption network.
Switch value input 1	Available if connecting with Battery -
Switch value input 2	Available if connecting with Battery -
Working condition	-25-65°C
Storage condition	-40-85°C
Overall dimension	106.5mm*74mm*31mm
Weight	0.15Kg


Overall Dimension and Wiring Diagram

◆ Overall Dimension:

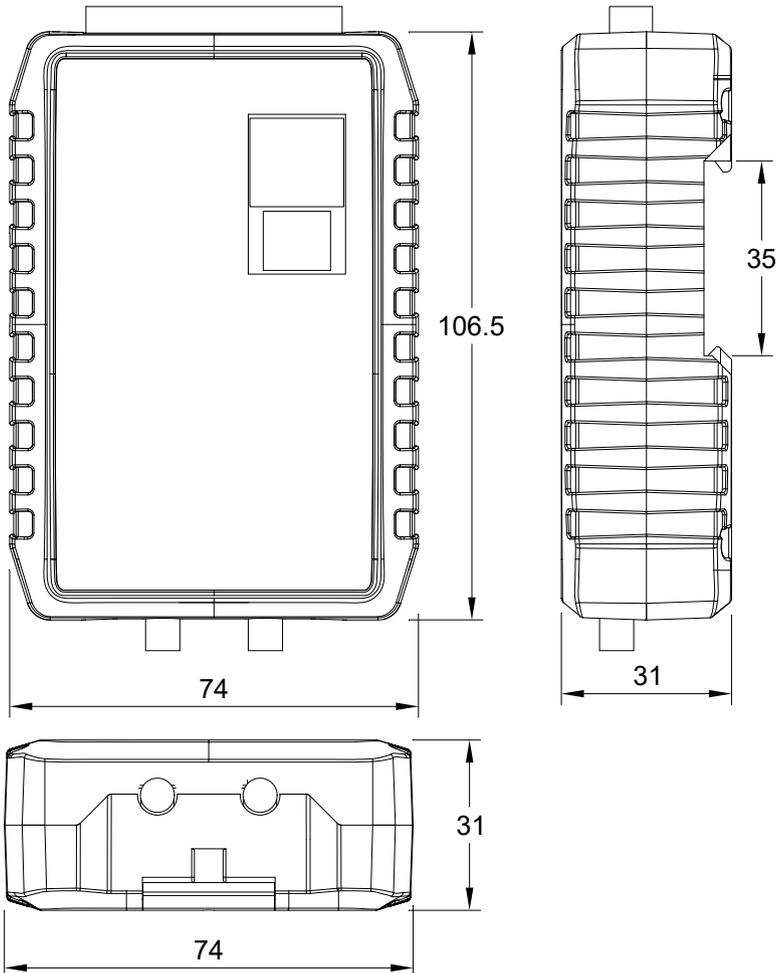



Installation instruction

◆ 35mm guideway installation:

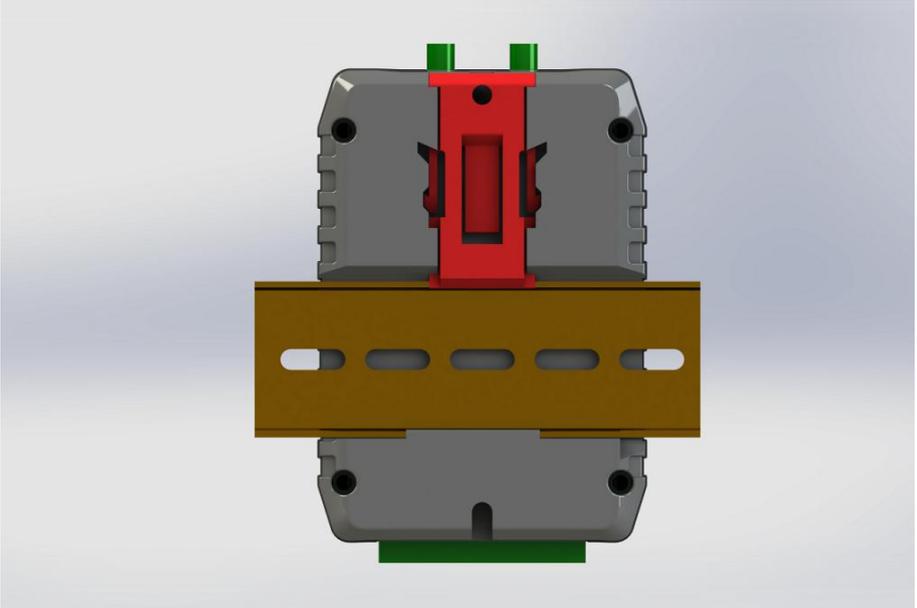

◆ Screw (M4) installation:

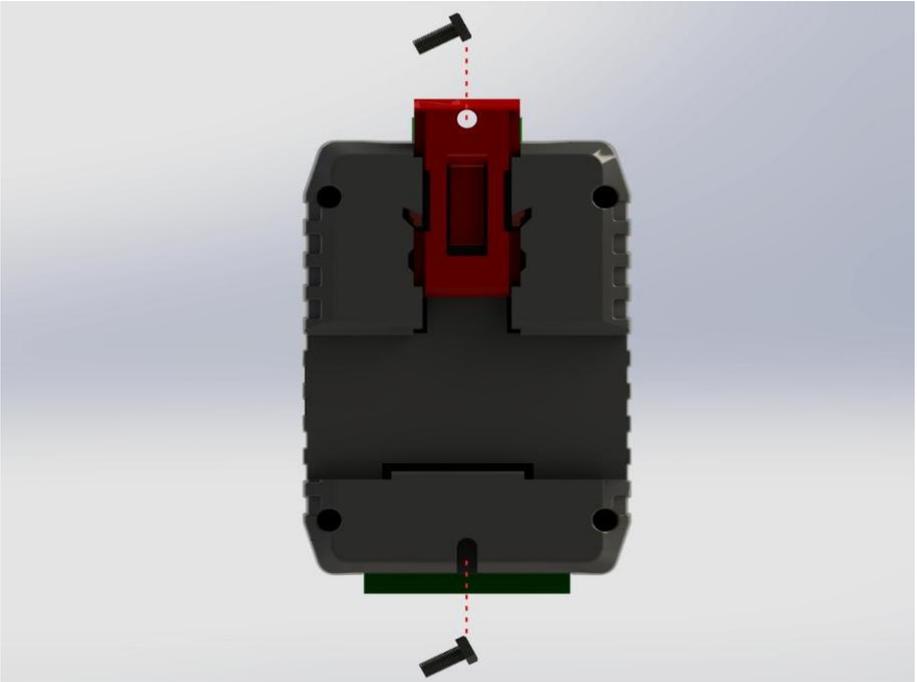

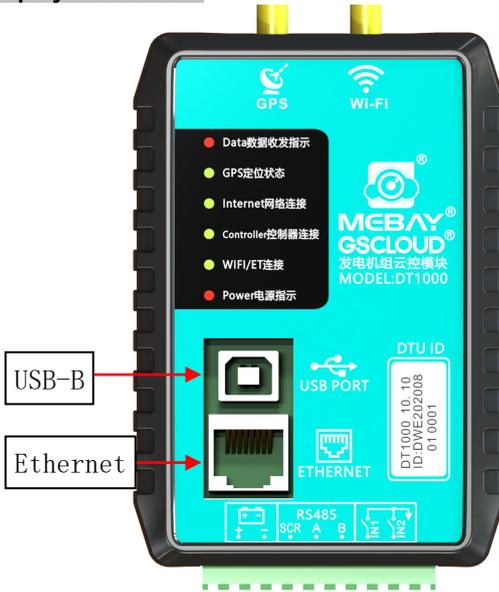Panel and display Instruction

◆ Panel instruction

Indicator name	Main function
Data	DTU sends data in red for LED lights and green for LED lights when receiving data.
GPS	The GPS module successfully obtains the positioning information and lights it up.
Internet	Lights up after a successful connection to the Internet network.
Controller	When the DTU is successfully connected to the controller, the LED lights up.
WIFI/ET	When the DTU connects to the WIFI/ET successfully, the LED lights up.
Power	After the module is turned on, the LED lights up.

◆ Port description:


No.	Function	Description	Cable cross sectional area
1	Power +	DC8V to 36V continuous power supply	1.0mm ²
2	Power -		1.0mm ²
3	RS485-SCR	RS485 port	0.5mm ²
4	RS485-A		0.5mm ²

5	RS485-B		0.5mm ²
6	Aux. Input 1	Ground connected is active (B-).	0.5mm ²
7	Aux. Input 2	Ground connected is active (B-).	0.5mm ²
8	USB Device	Type B USB port	
9	Ethernet RJ45	RJ45 interface network cable	


Operation

◆ **Communication and port functions:**

RS485 port: Connect to the RS485 port of the generator controller through the RS485 port:

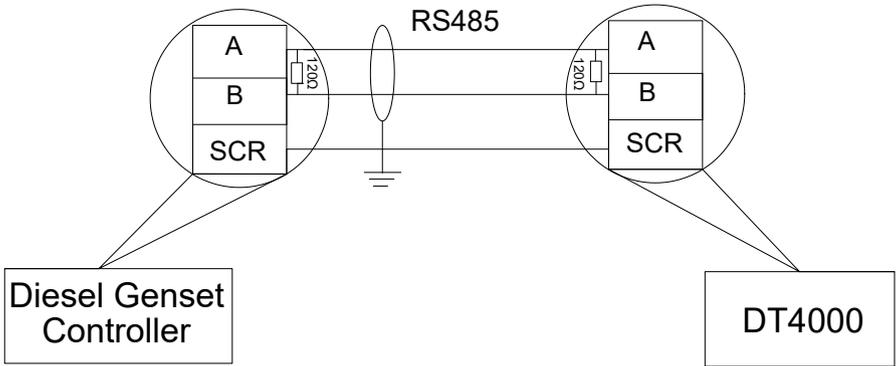

USB Device: USB port and PC USB port connection, can be parameter settings, module ID and registration password.

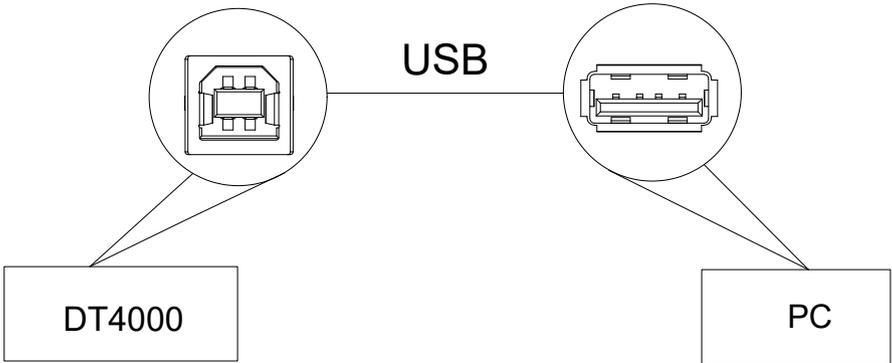


- ◆ **WIFI port :** Connect the WIFI IPX antenna to the Antenna port (50Ω/SMA female socket); Support 802.11b/g/n standard.
- ◆ **ETHERNET RJ45:** Connect the network cable to the RJ45 network interface.
- ◆ **GPS port:** When using GPS positioning function, GPS antenna is connected to DTU module, antenna port: 50 Ω / SMA master, active antenna.


 **Note:** GPS antenna needs to be placed outside the open, otherwise the position information is inaccurate or can not get the position information.

 **Note:** The GPS antenna and the WIFI antenna cannot be reversed.

◆ **System application diagram**

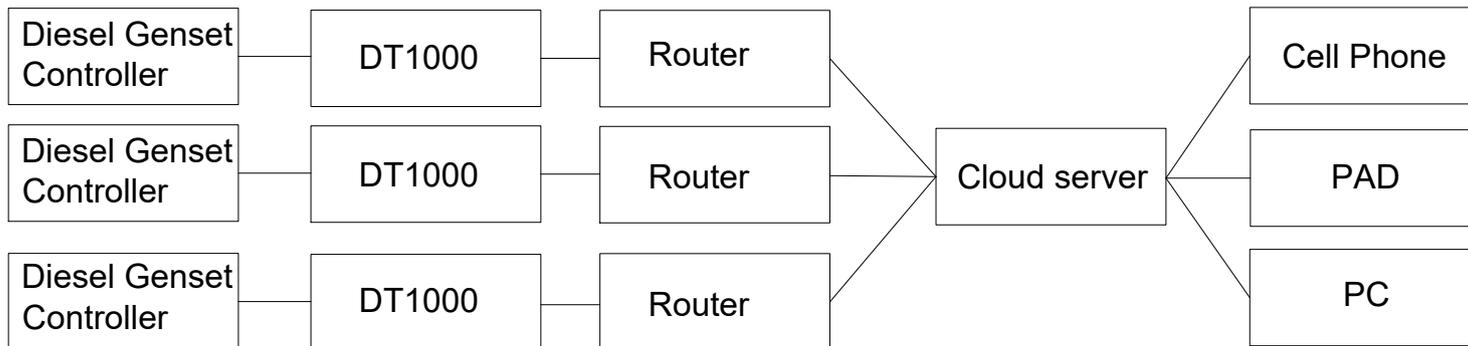

◆ **Typical Wiring Diagram**

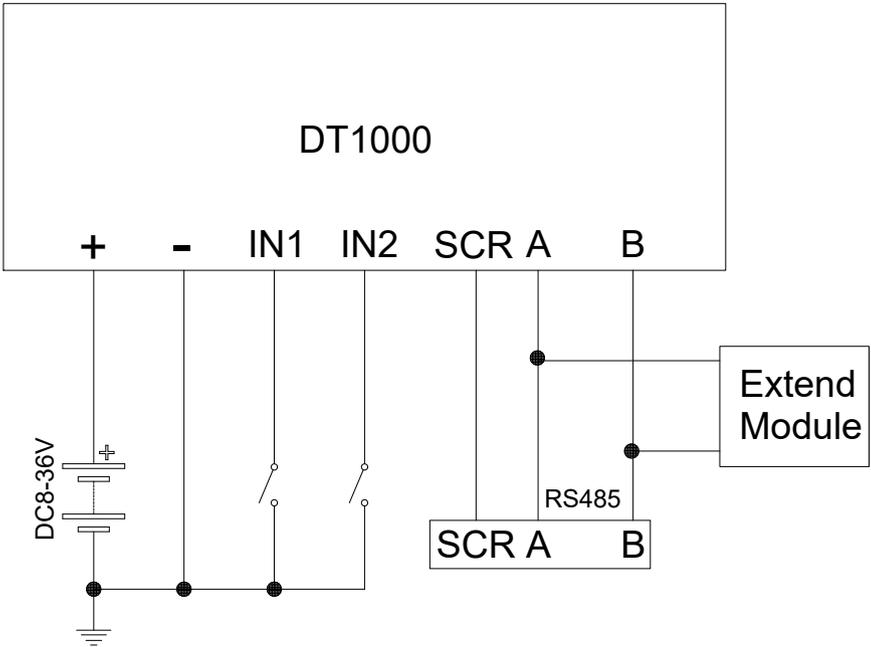

Parameter list.

1. GPS

No	Parameter	Range (default)	Notes
1	GPS functional enable	0-1 (1)	0:manual input; 1:GPS module acquisition position
2	Set Longitude	-180°-180° (0.00000)	Manual entry of communication module GPS location, altitude
3	Set latitude	-90°-90° (0.00000)	
4	above sea level	-9999.9-9999.9m (100.0m)	

2. WIFI/ET

No	Parameter	Range (default)	Notes
1	DHCP Enable	0-1 (1)	0:Manual input; 1:Auto obtain IP address.
2	IP Address	0-255 (192.168.0.1)	All changes of Ethernet (like IP address, Subnet address) are active after module rebooting.
3	Subnet Mask	0-255 (255.255.255.0)	
4	Default Gateway	0-255 (192.168.0.1)	
5	DNS Address	0-255 (192.168.0.1)	

6	SSID	(0-65535)	32 characters
7	Password	(0-65535)	64 characters

3. Switch input function setting

No	Parameter	Range (default)	Notes
1	Aux. Input 1	0-9(0: disable)	0: disable 1: Remote Control Inhibited 2: Access Alarm Input 3: Fire Alarm Input 4: Louver status input 5-9: Reserved
2	Aux. Input 2	0-9(0: disable)	

4. Communication Settings

No	Parameter	Range (default)	Notes
1	485 baud rate	9600-38400(19200)	Baud rate of Communication between DTU and Controller.
2	Running data upload interval	10-170S(10)	The interval between uploading data to the server while the generator is running.
3	Standby data upload interval	90-170S(90)	The interval between uploading data to the server while the generator is standby.

5. Model selection of generator controller

No	Parameter	Range (default)	Notes
1	MEBAY	DC18D DC20D MKII DC30D series DC4/5/6/7XD series DC4xS/C/T series DC42MR series DC8XD/DC9XD series DC100D series GM5X GM70X	Match the controllers of produced by MEBAY series.
2	Other companies	MEC20 DSE6120 HGM6120 HGM6110 AGC150 SGC120 SGC420 HGM9510	Match the controllers of other companies.

6. Extended module setting

No	Parameter	Range (default)	Notes
1	Temperature and humidity module	0:Disable 1:Enable	Sets whether the temperature and humidity detection module is enabled.
2	Alarm value for excessive ambient temperature.	0-80 (40) ℃	When the ambient temperature is higher than this setting value, upload the alarm information with too high ambient temperature, and disable this alarm when set to the minimum value.
3	Alarm value of too low ambient temperature	-30-50 (4) ℃	When the ambient temperature is lower than this setting value, upload the alarm information of the environment temperature is too low, set to the maximum value to disable this alarm.
4	Temperature, humidity and CO module.	0:Disable 1:Enable	Sets whether the temperature, humidity and carbon monoxide concentration detection module is enabled.
5	CO concentration over high alarm value	0-2000ppm (250ppm)	When the carbon monoxide concentration is higher than this setting value, upload the carbon monoxide concentration alarm information, set to the maximum value to disable this alarm.

Fault Finding

Symptoms	Possible Solutions
Controller no response with power.	Check power voltage. Check controller connection wiring.
All LED lights are on.	Check network cable to the RJ45 network interface. Check if the WIFI IPX antenna is connected to the antenna port.
Network LED not light up	Check whether the Ethernet parameter settings are normal. Check whether the network cable is normal.
GPS Not Gained Location	Check GPS parameters are enabled or not. Check GPS antenna is connected or not and placed outdoor or not. Check that the GPS antenna is placed outside the open room.
RS485 Communication Abnormal	Check connections Check settings of genset ID and baud rate are correct or not. Check that A and B of RS485 are reversed.
USB Port	Check connections

Communication Abnormal	Check whether the USB port of the computer is normal Check whether the driver is installed normally Check that the controller is properly energized
---------------------------	---